

F400 class

COOLING TOWER

specifications




F400 Cooling Tower – Contents

Specifications / Base

Base	4
Thermal Performance	4
Design Loading	5
Circulating Water Quality	5
Structure	6
Fan Deck and Fan Cylinders	7
Fill and Drift Eliminators	8
Mechanical Equipment	8
Casing	10
Hot Water Distribution System	10
Cell Partitions	11
Access and Safety	11
Scope of Work	12

Specifications / Options

Premium Hardware Options	
Level 1 - Epoxy-Coated Galvanized Steel	13
Level 2 - Type 316 Stainless Steel	13
Level 3 - Duplex Stainless Steel	14
Driveshaft Material Options	
All Stainless Steel Driveshaft	15
Carbon Fiber Driveshaft / Stainless Steel Couplings	15
Access and Maintenance Options	
Fiberglass Ladder	16
Steel Ladder	16
Second Stairway at End of Tower	16
Enclosed Stairway	16
Mechanical Equipment Temporary Access Walkway	17
Mechanical Equipment Permanent Access Walkway	17
Endwall Davit	17
Miscellaneous Options	
Fan Cylinder View Port	18
Vibration Limit Switch	18
Low Oil Switch	18
Other Available Options	19

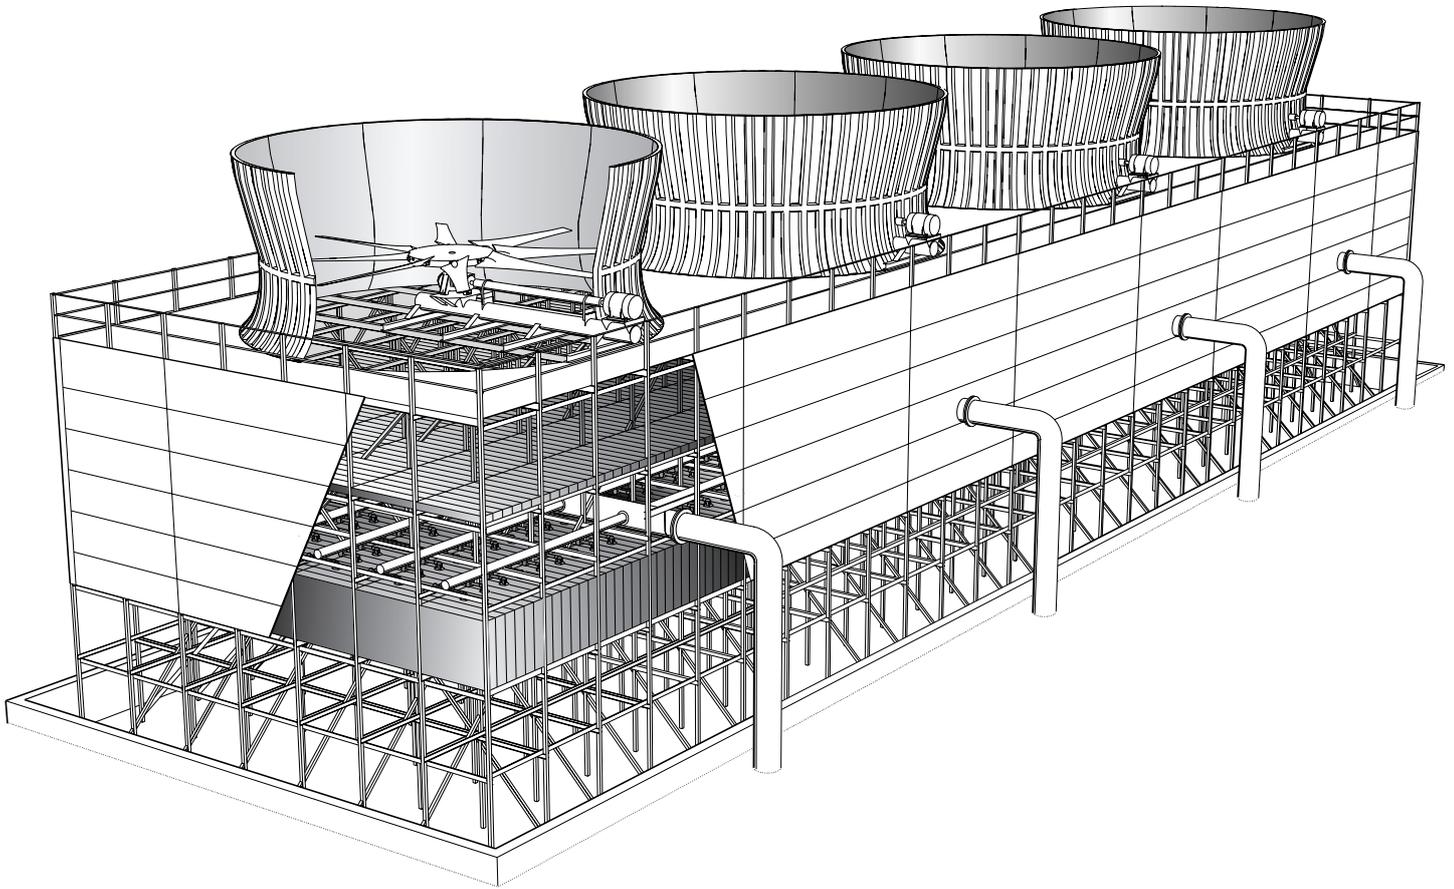

F400 towers are field erected, heavy duty, film fill, counterflow cooling towers, designed to serve all normal cooling water systems. Structural components are inert fiberglass composite pultrusions. The F400 cooling tower represents the current generation of towers that were the basis of SPX Cooling Technologies' Marley and Balcke brands entrance into the cooling tower marketplace over a century ago and incorporate years of design advancements that customers have found valuable. The F400 represents the current state of the art in this cooling tower category.

This publication not only relates the language to use in describing an appropriate F400 cooling tower—but also defines why certain items and features are important enough to specify with the intention of insisting upon compliance by all bidders. The left hand column of all pages provides appropriate text for the various specification paragraphs, whereas the right hand column comments on the meaning of the subject matter and explains its value.

Pages 4 through 12 indicate those paragraphs that are descriptive of a cooling tower which will not only accomplish the specified thermal performance, but which will include all normal operation and maintenance enhancing accessories and features. It will also incorporate those standard hardware materials which testing and experience has proven to provide best results in normal operating conditions.

Pages 13 through 18 provide some paragraphs intended to add those features, components, and materials that will customize the tower to meet the user's requirements.

Space does not permit definition and explanation of all of the possible options that can be applied to the F400 cooling tower. We realize that you, the purchaser, must be happy with the tower's characteristics, and we are prepared to provide—or provide for—any reasonable enhancement that you are willing to define and purchase.

Specifications	Specification Value
<p>1.0 Base:</p> <p>1.1 Furnish and install an induced draft, counterflow type, field erected, fiberglass framed, film fill, industrial duty cooling tower of ____ cell(s), situated as shown on the site plan. The limiting overall dimensions of the tower shall be ____ m wide x ____ m long x ____ m high to the top of the fan cylinders. Total operating power of the fans shall not exceed ____ kW.</p> <p>2.0 Thermal Performance:</p> <p>2.1 The tower shall be capable of cooling _____ m³/hr of water from ____ °C to ____ °C at a design entering air wet-bulb temperature of ____ °C. The cooling tower manufacturer shall guarantee that the tower supplied will meet the specified performance conditions when the tower is installed according to plans. If, because of a suspected thermal performance deficiency, the owner chooses to conduct an on-site thermal performance test in the presence of the manufacturer, and under the supervision of a qualified, disinterested third party in accordance with CTI (Cooling Technology Institute) ATC-105 standards during the first full year of operation; and if the tower fails to perform within the limits of test tolerance; then the cooling tower manufacturer shall make alterations as it deems necessary to overcome indicated deficiency. Should alterations prove to be inadequate, the owner, at the cooling tower manufacturer's option, shall be compensated by either (or a combination of both) of the following: (a) Installation of additional cooling tower capacity; (b) A refund of a percentage of the contract price proportional to the deficiency as established.</p>	<p>■ The base of your specification establishes the type, configuration, base material, and physical limitations of the cooling tower to be quoted. During the planning and layout stages of your project, you may have focused your attention on a cooling tower selection that fit your space allotment, and whose power usage was acceptable. Limitations on physical size and total operating horsepower avoid the introduction of operational and site-related influences. Even further control of these issues will result if you specify the number of cells, and the maximum fan kW/cell.</p> <p>You are specifying a counterflow tower, which is a type noted—and usually specified—for its economical use of ground space on projects where the required thermal performance is very difficult. The one you have chosen to specify utilizes film-fill, which normally provides maximum cooling effect in significantly less area than would be required by a splash-fill cooling tower.</p> <p>You are also specifying materials of construction which are impervious to the ills that beset towers constructed of more traditional materials. Life expectancy is not typically a characteristic of concern in this tower.</p> <p>Note: If it is your intention to evaluate offerings on the basis of first cost, plus the cost of ownership and operation, please be clear on your inquiry documents regarding the parameters under consideration, as well as the value that you intend to place upon each of them. (i.e. cost per kW; cost per meter of pump head; cost per m² of basin area, etc.) They WILL affect the sizing of the tower.</p> <p>■ Your reason for purchasing a cooling tower is to obtain a continuing flow of cooled water as defined in the first paragraph at left. If the tower that you purchase is incapable of performing as specified, then you will not have received full value for your money.</p> <p>DIN or BS Standards might apply depending upon location. Substitute if preferred in place of CTI ATC-105 Standard.</p> <p>Bear in mind that the size—and cost—of a cooling tower varies directly with its true thermal capability. This paragraph is intended to protect you against either intentional or inadvertent undersizing of the tower by the manufacturer. Judging the level of performance of a cooling tower on critical processes is never easy, and the potential risk of a non-performing cooling tower usually causes the requirement for a mandatory acceptance test to be very desirable.</p> <p>Your contract with the successful bidder should establish the acceptable remedies for missed performance, which might include:</p> <ul style="list-style-type: none"> • The addition of one or more cells of tower, as necessary, to bring the cooling tower to the specified level of performance. This is usually limited to the scope of work as defined in the specifications, which means that you (the owner) will have to pay for the additional basin, wiring, starters, piping, etc. • The reimbursement of a portion of the total contract price equal to the percentage deficiency in performance. <p>Under no circumstances should you allow the manufacturer to repitch the fans to increase motor kW above that shown in the proposal. That creates additional operating costs that will continue for the life of the tower and imposes no penalty on the manufacturer.</p>

Specifications	Specification Value																						
<p>3.0 Design Loading:</p> <p>3.1 The tower and all its components shall be designed to withstand a wind load and a seismic load based on Eurocode. As a minimum, a stability load of 2 1/2% shall be applied to the structure. Fan decks and other work levels shall be designed for a uniform load of 300 kg/m², or a concentrated live load of 275 kg. Allowable deflection at 300 kg/m² uniform load shall be 1/180 of span. Fill and fill supports shall be capable of withstanding a 200 kg/m² live load. Guardrails shall be capable of withstanding a concentrated live load of at least 90 kg applied in any direction at any point along the top rail.</p> <p>4.0 Circulating Water Quality:</p> <p>4.1 It is anticipated that the circulating water will have the following characteristics:</p> <table border="0" style="width: 100%;"> <tr> <td>pH range</td> <td>_____ to _____</td> </tr> <tr> <td>Chlorides (NaCl)</td> <td>_____ mg/L</td> </tr> <tr> <td>Sulfate (SO₄)</td> <td>_____ mg/L</td> </tr> <tr> <td>Sodium Bic. (NaHCO₃)</td> <td>_____ mg/L</td> </tr> <tr> <td>Calcium (CaCO₃)</td> <td>_____ mg/L</td> </tr> <tr> <td>Oil or grease</td> <td>_____ mg/L</td> </tr> <tr> <td>Silica (SiO₂)</td> <td>_____ mg/L</td> </tr> <tr> <td>Max water temperature</td> <td>_____ °C</td> </tr> <tr> <td>Total suspended solids</td> <td>_____ mg/l</td> </tr> <tr> <td>Bacteria count</td> <td>_____ CFU/mL</td> </tr> <tr> <td>(Other)</td> <td>_____</td> </tr> </table> <p>4.2 The specifications, as written, are intended to indicate those materials that will be capable of withstanding the above water quality in continuing service. They are to be regarded as minimum requirements. Where components peculiar to individual tower designs are not specified, the manufacturer shall take the above water quality into account in the selection of their materials of manufacture.</p>	pH range	_____ to _____	Chlorides (NaCl)	_____ mg/L	Sulfate (SO ₄)	_____ mg/L	Sodium Bic. (NaHCO ₃)	_____ mg/L	Calcium (CaCO ₃)	_____ mg/L	Oil or grease	_____ mg/L	Silica (SiO ₂)	_____ mg/L	Max water temperature	_____ °C	Total suspended solids	_____ mg/l	Bacteria count	_____ CFU/mL	(Other)	_____	<p>■ Although very strong, FRP decking material is relatively flexible. For this reason, it is important to limit deflection at design load to no more than 1/180 of span. Otherwise, decking and working platforms would be much too springy for the appropriate and comfortable handling of equipment.</p> <p>The indicated design values are the minimum allowables under normal design standards. If your geographic location dictates higher wind load, seismic load, or deck loading values, please make the appropriate changes.</p> <p>■ For purposes of this specification, "normal" circulating water conditions are defined as follows:</p> <ul style="list-style-type: none"> • A pH level between 6.5 and 9.0. • A chloride content below 750 ppm (as sodium chloride) – or below 455 mg/L (as chloride). • A sulfate content (SO₄) below 1200 mg/L. (sulfates can attack concrete, and contribute to scale.) • A sodium bicarbonate (NaHCO₃) content below 300 mg/L. • Calcium (CaCO₃) below 800 mg/L. • Oil and/or grease negligible. • Silica (SiO₂) below 150 mg/L. • A maximum hot water temperature of 50°C. • Total suspended solids (TSS) below 50 mg/L. • A bacteria count <10,000 CFU/mL. • No significant contamination with unusual chemicals or foreign substances. <p>If your circulating water quality falls outside any of the parameters listed above, some changes in the materials specifications may be required, most of which are listed on pages 13 thru 15. Where there is any question in your mind, please provide SPX Cooling Technologies with an analysis of your makeup water, along with the number of concentrations you intend to permit in your circulating water. Better still, since the quality of the water in a cooling tower soon reflects the quality of the surrounding air, an analysis of the circulating water from another cooling tower on site, if one exists, might be very informative.</p> <p>Except for those unusual operating situations where the circulating water may be so laden with suspended solids, algae, fatty acids, product fibers, active organisms reflected in BOD, and the like that plugging of the cooling tower fill is a probability, reasonable attention to the hardware materials and/or their coatings is all that is normally required. Please work with your SPX Cooling Technologies sales representative.</p>
pH range	_____ to _____																						
Chlorides (NaCl)	_____ mg/L																						
Sulfate (SO ₄)	_____ mg/L																						
Sodium Bic. (NaHCO ₃)	_____ mg/L																						
Calcium (CaCO ₃)	_____ mg/L																						
Oil or grease	_____ mg/L																						
Silica (SiO ₂)	_____ mg/L																						
Max water temperature	_____ °C																						
Total suspended solids	_____ mg/l																						
Bacteria count	_____ CFU/mL																						
(Other)	_____																						

Specifications	Specification Value
<p>5.0 Structure:</p> <p>5.1 Tower framework shall consist of structural shapes of pultruded fiberglass composites having a flame spread rate of 25 or less. Columns and diagonals shall be 76mm x 76mm or larger box-section, with a minimum 6mm wall thickness. Columns shall be spaced on no greater than 1.8m centers transversely and 2.7m centers longitudinally. Columns requiring anchorage shall be anchored to the concrete cold water basin by heavy-gauge series 300 stainless steel anchor clips.</p> <p>5.2 Except at fill and fan deck support levels, longitudinal and transverse girts shall be 102mm channel sections located on both sides of interior columns; and on the inside of all perimeter columns. Girts at the fill and fan deck support levels shall typically be 152mm channel sections. These members sizes may vary depending on tower loading. Girt lines shall be located on vertical centers not to exceed 1.9m, except as may be required in towers requiring fill heights that would encounter the girt line. In that case, the lower girt line in the fill area may be lowered to provide room for the fill.</p> <p>5.3 A tension/compression system of diagonal braces shall stiffen the structure and transfer wind and seismic loads to the basin anchor points. Diagonal connectors used to transmit forces through column lines shall be of 13mm pultruded fiberglass plates. Diagonals shall be anchored to the cold water basin using heavy gauge series 300 stainless steel anchor clips. The line of action through the diagonal to the point of anchorage shall be straight.</p> <p>5.4 All structural connections and splices shall be through-bolted using full shank M12, or larger, series 300 stainless steel machine bolts, nuts and washers. Glued structural connections will not be allowed.</p> <p>5.5 Critical framing joints shall be augmented with 12mm ID, 21mm OD structural sleeves of series 300 stainless steel or fiberglass pultrusion. Framing specific to those joints shall be factory-drilled to accept insertion of the sleeves. Bidders shall include with their quotation complete framework wind and/or seismic diagrams along with column operating and shutdown point loads for all models quoted, based upon the specified performance and design loadings.</p>	<p>■ Where the tower's incoming hot water temperature consistently exceeds 50°C, the strength characteristics of the pultruded fiberglass may be reduced, particularly in the distribution area of the tower. Depending upon the size of the tower, and the resultant safety margins, some changes in member sizes or resins used may be required.</p> <p>SPX Cooling Technologies has produced a number of publications having to do with both the science, and the art of designing cooling towers and are available for download from our website. <i>Marley Difference</i> "Item S-7" of that series discusses diagonals, and explains the need to maintain a straight "line of action" throughout the diagonal.</p> <p>Series 300 stainless hardware is appropriate for the "normal" water conditions defined on page 5. If your air or water quality dictates hardware of higher premium (i.e. epoxy coating, 316 stainless steel, etc.), please see pages 13 through 15, and discuss your requirements with your SPX Cooling Technologies sales representative.</p> <p>The resin-rich surface veil applied to all molded or extruded FRP parts makes field-gluing inappropriate and structurally inadequate. Having no fiber content, this veil is the weakest area of the part, and must be properly removed to permit bonding to the fibrous structural layer. This is very difficult under field conditions and, coupled with the absence of any temperature and humidity control, makes field-glued joints not only ineffective, but potentially dangerous.</p> <p>To have structurally designed their offerings, bidders will have had to develop the framework wind and/or seismic. Please require them.</p>   

Specifications

Specification Value

6.0 Fan Deck and Fan Cylinders:


6.1 The fan deck shall act as a working platform for maintenance personnel. It shall be pultruded fiberglass having a flame spread rating of 25 or less with a top surface at least 3mm thick and shall have a slip resistant surface. Fan deck panels shall be supported by framing girts and shall interlock along the lengths of the panels to prevent differential deflections between panels. To minimize turbulence of airflow into the fan cylinder, fan deck protrusion into the fan cylinder opening shall not exceed 25mm.

6.2 Fan cylinders shall be molded FRP, no less than 2.1m high with eased inlets to promote smooth airflow at blade tips. The operating plane of the fan shall be at a level above the fan deck of at least 15% of the overall fan diameter. Fan tip clearance shall not exceed 0.5% of the fan diameter. If velocity recovery fan cylinders are used, they shall have a maximum flare angle of 12°, with a maximum assumed velocity recovery of 75% of the difference in average velocity pressure. Each fan cylinder segment shall be through-bolted to both the fan deck and a primary fan deck framing member. Fan cylinder connection and anchorage hardware shall be series 300 stainless steel.

■ Fiberglass-reinforced polyester fan cylinders provide the close tip clearances and smooth airflow contour necessary for good fan performance. The inert, non-corroding nature of FRP assures that these characteristics will persist. *Marley Difference* "Item A-1a" explains the need for the specification language indicated at left.

If fire-retardant FRP is required or preferred for fan cylinders, please add the words **"having a flame spread rate of 25 or less"** after "FRP".

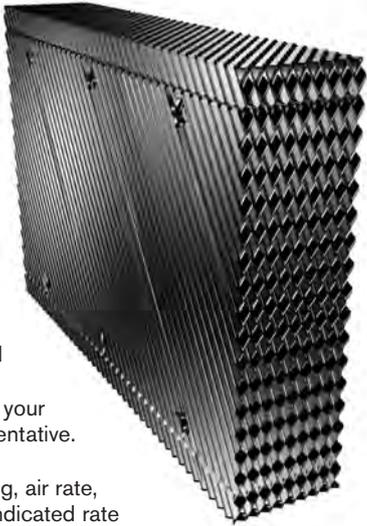

Specifications	Specification Value
<p>7.0 Fill and Drift Eliminators:</p> <p>7.1 Fill shall be cellular film-type, thermoformed PVC, manufactured of .31mm or heavier stock and shall be assembled into sturdy packs. Fill shall be supported as required to accommodate construction loads and operational loads and the specified 195 kg/m² live load, as well as ice loads in freezing climates.</p> <p>7.2 Drift eliminators shall be thermoformed of .43mm or heavier PVC. They shall be cellular type, triple-pass, and shall limit drift losses to no more than 0.005% of design m³/hr flow rate. They shall be factory-assembled into easily-handled packs that nest together to form a continuous plane of drift eliminators throughout the plan area of each tower cell. Eliminators shall be supported by framing girts on no greater than 1.8m centers.</p> <p>8.0 Mechanical Equipment:</p> <p>8.1 The primary air delivery system for each cell shall consist of an electric motor, an extended driveshaft, a geared speed-reduction unit, a multi-bladed axial-type fan, and a rigid unitized support.</p> <p>8.2 Motors shall be ____-speed, ____-winding, variable torque, ____ kW maximum, TEFC, and specially insulated for cooling tower duty. Speed and electrical characteristics shall be ____ RPM, ____ Phase, ____ Hz, ____ Volts. Motors shall have a ____% nameplate rating.</p> <p>8.3 Motors shall be located outside the fan cylinders and shall be connected to the speed reducers by tubular, extended, full floating, non-lubricated driveshafts. Driveshaft tubes and flanges shall be manufactured of type 304 stainless steel. Couplings shall be hot dip galvanized cast iron, joined to the driveshaft by flexible neoprene bushings and type 316 stainless steel inserts. Connecting hardware shall be 300 stainless steel. Driveshaft assemblies shall be dynamically balanced at the factory at full motor speed. Two galvanized steel driveshaft guards anchored to the mechanical equipment support shall surround the driveshaft for containment in the event of failure.</p>	<div style="display: flex; align-items: flex-start;"> <div style="flex: 1;"> <ul style="list-style-type: none"> ■ In film-fill counterflow towers, great care is taken to assure full and even coverage of the fill with circulating water. Multiple layers of fill packs tend to defeat this effort by causing the water to redistribute itself after each layer. Minimizing the number of layers will assure minimal airflow disruption and reduce the tendency for fill fouling. <p>The water temperature limit of normal PVC film fill depends upon configuration. In order to optimize your fill material selection, please discuss your expected normal and excursion temperatures with your SPX Cooling Technologies sales representative.</p> <p>Drift rate varies with design water loading, air rate, drift eliminator depth, and density. The indicated rate of 0.005% is easily achievable without premium cost. If a lower rate is required, please discuss with your SPX Cooling Technologies sales representative.</p> <ul style="list-style-type: none"> ■ • Typical speed choices are “single” or “two”. Two-speed motors are worthy of your consideration because of the increased controllability they offer – and because of their significantly reduced annual power requirements. • For 50 Hz power, single-speed design is 1500 RPM, and normal two-speed design is 1500/1000 RPM. <p>Change the motor specifications to indicate the characteristics you require. Dual winding, explosion proof, 1500/1000 RPM, space heaters, etc.</p> <ul style="list-style-type: none"> ■ The driveshaft turns at the motor speed and is, therefore, most sensitive to operational imbalance. Stainless steel manufacture assures that the driveshaft will not become unbalanced as a result of corrosion. <p>See page 15 for optional all stainless steel, and carbon fiber driveshafts.</p> </div> <div style="flex: 1; text-align: center;">  </div> </div>

Specifications

- 8.4 Gear reduction units shall be rightangle type, utilizing helical and/or spiral bevel matched gear sets. Cases shall be epoxy-coated, ASTM Class 20, gray cast iron. Bearings shall be tapered roller type. Gears and bearings shall be splash-lubricated in a bath of turbine type mineral oil, and units shall be capable of operating in either forward or reverse with equal facility. Speed reduction units using external oil pumps will not be allowed. Gear reducers shall meet or exceed the requirements of CTI STD-111 and AGMA Std. 420.04, and service factor at applied power shall not be less than 2.0. They shall be run-in under load and adjusted at the factory, and the interior surfaces coated with a rust-proofing oil prior to shipment.
- 8.5 Each cell shall be equipped with an external oil level gauge and gear reducer drain line, terminating at the fan cylinder near the motor.
- 8.6 Fans shall have a minimum of six GRE (glass reinforced epoxy) or FRP blades, with appropriate twist and taper to produce maximum airflow. All blades shall be fabricated with consistent moment weights to permit the change-out of individual blades without the need for total fan rebalance. Hubs shall be fabricated of hot dip galvanized steel and ductile cast iron, assembled with series 300 stainless steel hardware. Spoke-type hubs, if used, shall be equipped with an FRP hub cover to prevent recirculation of air at the plane of the fan. Hubs shall be statically balanced at the factory.
- 8.7 The complete mechanical equipment assembly for each cell shall be supported by a rigid, unitized, torque-tube type support that prevents misalignment between the motor and the gear reducer. Support shall be heavy-wall tubular steel, to which heavy plate platforms for the motor and gear reducer have been welded, as well as structural outriggers to provide structural stability and transmit loads into the tower structure. The assembly shall be hot dip galvanized after fabrication.

Specification Value

- The Geareducer[®] is, essentially, the heart of your fan drive system. It must support the fan, rotate the fan at the appropriate speed, and maintain critical fan positioning within the fan cylinders—and must perform these functions reliably through many years of demanding use.

Requiring adherence to the standards specified helps to assure that level of dependability.

The extended oil line to an external gauge provides a means of checking the level of oil in the Geareducer. It also permits periodic oil changes at a convenient location.



- Many of the large fans used on cooling towers operate at tip speeds approaching 66 m/s. When the blade tips encounter the occasional solid droplet of water that escapes the eliminators, erosion of the leading edge can occur on fans whose designs do not address this problem. This has, over time, contributed to some fan failures in the past.

Fans of the size used on large cooling towers are applied at speeds and fan power that generate considerable torque – and structural tubular steel resists this torque most effectively. The torque-tube design assures that all of the mechanical equipment remains aligned, and that the rotating fan is properly positioned within the fan cylinder. Hot dipping after fabrication assures that all steel surfaces will be heavily coated with zinc for long-term protection against corrosion.



Specifications	Specification Value
<p>9.0 Casing:</p> <p>9.1 The endwalls and sidewalls of the tower above the air inlet elevation, shall be cased with 2.5 kg/m² or greater, depending on longitudinal bay length, rib-type FRP panels attached to tower columns with stainless steel screw shank, self-tapping fasteners and self-sealing washers. Panels shall be lapped to shed water inward to the tower. Vertical joints shall be lapped and sealed watertight. Casing ends at tower corners shall be covered with 4 kg/m² FRP 90° corner rolls.</p> <p>10.0 Hot Water Distribution System:</p> <p>10.1 Hot water shall be distributed to the fill in each cell via a system of headers, laterals, branch arms, and nozzles, installed in the region above the fill and beneath the drift eliminators. Headers may be either RTR (reinforced thermosetting resin) or PVC. Laterals shall be PVC. Branch arms and nozzles shall be injection-molded polypropylene. The joint between branch arms and nozzles shall be threaded so nozzles can be easily removed for cleaning of the branch arms. Nozzles shall be of the large orifice, low-pressure, down-spray type, having no moving parts or restrictors that will promote clogging.</p> <p>10.2 The piping system shall be sized for a flow velocity that will insure relatively equal flow to all areas of the cooling tower fill. Headers shall be equipped with individual flanged inlets, drilled to conform to DIN 2673, DIN 2501 and PN10 requirements, located approximately 300mm outside the tower casing at or near the transverse centerline of each cell. Except for towers with 1.2m plenum heights, headers shall be vented to atmosphere by an open standpipe at the downstream end of the header.</p>	<p>■ If preferred, change casing weight from 2.5 kg/m² to 4 kg/m².</p> <p>Also, if fire-retardant casing is preferred, it would be appropriate to add the following sentence to the end of the paragraph at left: "Casing panels and corner rolls shall have a flame spread rate of 25 or less."</p> <p>■ This "side inlet" method of piping the cooling tower requires you to provide a header at the base of the tower, along with separate risers for each cell. Using this method, you may conveniently valve off cells on an individual basis.</p> <p>In cold weather regions, you should also consider running a drain line from the riser to the cold water basin to drain the riser during shutdown in freezing weather. Bypasses, if used, should be designed only after thorough discussion with your SPX Cooling Technologies' sales representative.</p> <p>Water distribution in a cooling tower should be relatively equal throughout. Distribution systems which create uneven water distribution promote reduced tower performance by developing high water concentration areas which block air flow and/or low water concentration areas which create air bypass regions.</p>  

Specifications	Specification Value
<p>11.0 Cell Partitions:</p> <p>11.1 The tower shall be partitioned such that the fan of each cell can be operated and cycled independently of the remaining cells. Full-width, 2.5 kg/m² FRP panel partitions shall extend from casing to casing across the tower, and from the top of the fill upward to the underneath side of the fan deck floor.</p> <p>11.2 A full-length, 2.5 kg/m² FRP panel partition shall extend from endwall to endwall along the approximate centerline of the tower, rising from the normal operating water level to the underneath side of the fill. If endwalls are open for air entry, wind walls shall extend inward at an approximate 45° angle from the corner columns of the end cells to meet the longitudinal partition. The purpose of this partition system will be to prevent falling water from being blown out the leeward face of the tower.</p> <p>12.0 Access and Safety:</p> <p>12.1 The tower shall be designed and equipped to provide comfortable, safe access to all components requiring routine inspection and maintenance.</p> <p>12.2 The fan deck of the tower shall be surrounded by sturdy 102mm x 102mm pultruded FRP angle top rail and toeboard plus an 89mm pultruded FRP channel intermediate rail, all conforming to CE/OSHA standards. The guardrail shall be 1.1m high. Top rails and intermediate rails shall be through-bolted to 76mm x 76mm columns both longitudinally and transversely. The toeboards shall be fastened to the tower columns or guardrail posts with self drilling/self tapping screws.</p> <p>12.3 One endwall of the tower shall be equipped with a structural fiberglass stairway rising from the level of the cold water basin curb to the fan deck. Stairs shall be 762mm wide with a slope of 41.5° and have an 200mm rise and 230mm run. Treads shall have a nonskid surface. Landings shall occur at 1.8m elevations. Handrails and kneerails shall be 50mm x 50mm, through-bolted to 76mm x 76mm stairway posts. All stairway bolts and fasteners shall be series 300 stainless steel.</p>	<p>■ Multicell towers must have air plenum partitions between cells. Otherwise, air will be induced downward through an inoperative fan, bypassing the fill of the operating cell. Without these partitions, part-load or off-season operation of the tower would be completely unsatisfactory.</p> <p>Unless complete separation between cells is required for reasons of system operation, partitions in the fill area of film-fill counterflow towers serve no useful purpose. There is no tendency for distributed water to wander excessively beyond the limits of the tower cell.</p> <p>Without these wind walls, the area surrounding counterflow towers would quickly become unsightly—or in wintertime, potentially dangerous.</p> <p>■ The rigors of normal industrial cooling tower operation require that all vital areas of the tower be readily, easily, and safely accessed.</p> <p>Be extremely wary of those manufacturers who suggest that one of your access requirements is not really necessary. Their suggestion may be evidence that such access in their design is difficult—and may very well become a focus of significant cost to you in the future.</p> <p>■ Stairways are also available at both ends of the tower; and cased for snow and ice protection. In lieu of a stairway, you may only need or want an access ladder. See page 16.</p>



Specifications	Specification Value
<p>12.4 Each cell shall have a 915mm square hinged access hatch in the fan deck floor, and a fiberglass ladder leading down to a landing at the drift eliminator level. A removal section through the eliminators lifts out for access into the spray chamber for nozzle cleaning and inspection.</p>	<ul style="list-style-type: none"> ■ The access doors on other towers may be unreasonably small. Specifying the size of the door will cause those bidders to take exception, alerting you to a potential maintenance headache. 
<p>12.5 Fan cylinders shall have removable segments for access to mechanical equipment components, and shall have a coupling guard, conforming to CE/OSHA standards, to shroud that portion of the driveshaft that extends outside the fan cylinder.</p>	
<p>13.0 Scope of Work:</p>	
<p>13.1 The cooling tower manufacturer shall be responsible for the design, fabrication, and delivery of materials to the project site, and for the erection of the cooling tower over a concrete basin and foundation. Cooling tower manufacturer will also supply anchor bolts. The concrete basin and foundation including stairway landing(s) shall have been designed and installed by others, based upon certified loads and dimensions provided by the cooling tower manufacturer. Unless otherwise specified, all external piping, headers, risers, valves, pumps, sumps and screens, controls, electrical wiring, fire protection, lightning protection, and water treatment equipment will be outside the cooling tower manufacturer's scope of work.</p>	<ul style="list-style-type: none"> ■ Please be clear in your specifications and inquiry documents regarding the full scope of work expected. That will help assure that your bid comparisons will be made on as equal a basis as possible—and will help to avoid any misunderstandings during the execution and implementation of the contract. 

Specifications	Specification Value
<p>Premium Hardware Options</p>	
<p>Level 1 - Epoxy-Coated Galvanized Steel</p>	
<p>8.3 <i>Change the last sentence to read:</i> Two triple-epoxy-coated, galvanized steel driveshaft guards anchored to the mechanical equipment support shall surround the driveshaft for containment in the event of failure.</p>	<p>■ All of the material changes listed under Level 1 are recommended where chlorides are below 1500 mg/L (as sodium chloride) or below 910 mg/L (as chloride) but acidity is less than pH 6.5 or in the presence of sulfides.</p> <p>The materials of construction indicated in the base specification are entirely suitable for the “normal” water conditions defined on page 5. If your water quality is typified by the conditions indicated in the description above, all of the changes indicated on this page may be required. However, many of the components mentioned are outside contact with the circulating water stream and, therefore, may not require specification revision. Bolts, nuts and washers, of course, are Series 300 stainless steel as standard.</p> <p>Also, several other water chemistries can occur that may or may not necessitate changes in materials of construction and/or operating procedures. Prior to finalizing the tower selection and specification, we ask that you provide us with your best analysis of what your circulating water quality and chemistry will be.</p> <p>The value of the specification revision is, of course, that they help assure you will have achieved maximum longevity from your cooling tower in its anticipated operating environment.</p>
<p>8.6 <i>Add the following sentence at the end of this paragraph:</i> Galvanized steel components shall be epoxy-coated after galvanizing to a dry film thickness of .31mm.</p>	
<p>8.7 <i>Change the last sentence to read:</i> The assembly shall be hot dip galvanized after fabrication, and epoxy-coated after galvanizing to a dry film thickness of .31mm.</p>	
<p>Level 2 - Type 316 Stainless Steel</p>	
<p>5.1 <i>Change the last sentence to read:</i> Columns requiring anchorage shall be anchored to the concrete cold water basin by heavy gauge type 316 stainless steel anchor clips.</p>	<p>■ All of the material changes listed under Level 2 are recommended where chlorides are between 1500 mg/L and 4000 mg/L (as sodium chloride) or between 910 mg/L and 2425 mg/L (as chloride).</p> <p>The materials of construction indicated in the base specification are entirely suitable for the “normal” water conditions defined on page 5. If your water quality is typified by the conditions indicated in the description above, all of the changes indicated on this page may be required. However, many of the components mentioned are outside intimate contact with the circulating water stream and, therefore, may not require specification revision.</p> <p>Also, several other water chemistries can occur that may or may not necessitate changes in materials of construction and/or operating procedures. Prior to finalizing the tower selection and specification, we ask that you provide us with your best analysis of what your circulating water quality and chemistry will be.</p> <p>The value of the specification revision is, of course, that they help assure you will have achieved maximum longevity from your cooling tower in its anticipated operating environment.</p>
<p>5.3 <i>Change the third sentence to read:</i> Diagonals shall be anchored to the cold water basin using heavy gauge type 316 stainless steel anchor clips.</p>	
<p>5.4 <i>Change the first sentence to read:</i> All structural connections and splices shall be through-bolted using full shank M12 diameter, or larger, type 316 stainless steel machine bolts, nuts and washers.</p>	
<p>6.2 <i>Change the last sentence to read:</i> Fan cylinder connection and anchorage hardware shall be type 316 stainless steel.</p>	
<p>8.3 <i>For a stainless steel driveshaft change the second, third and fourth sentences to read:</i> Driveshaft tubes and flanges shall be manufactured of type 304 stainless steel. Couplings shall be cast 316 stainless steel, joined to the driveshaft by flexible neoprene bushings and type 316 stainless steel inserts.</p>	
<p><i>Also, the last sentence to read:</i> Two triple-epoxy-coated, galvanized steel driveshaft</p>	



Specifications	Specification Value
<p>guards anchored to the mechanical equipment support shall surround the driveshaft for containment in the event of failure.</p> <p><i>For a carbon fiber driveshaft with 316 stainless steel couplings, replace entire paragraph 8.3 with the description found on pages 15 and 16.</i></p>	
<p>8.6 <i>Add the following sentence at the end of this paragraph:</i> Galvanized steel components shall be epoxy-coated after galvanizing to a dry film thickness of .31mm.</p>	
<p>8.7 <i>Change the last sentence to read:</i> The assembly shall be hot dip galvanized after fabrication, and epoxy-coated after galvanizing to a dry film thickness of .31mm.</p>	
<p>Level 3 - Duplex Stainless Steel</p>	
<p>5.1 <i>Change the last sentence to read:</i> Columns requiring anchorage shall be anchored to the concrete cold water basin by heavy gauge duplex stainless steel anchor clips.</p>	
<p>5.3 <i>Change the third sentence to read:</i> Diagonals shall be anchored to the cold water basin by heavy gauge duplex stainless steel anchor clips.</p>	
<p>5.4 <i>Replace the first sentence with the following:</i> All structural connections and splices shall be through-bolted using full shank M12 diameter, or larger, duplex stainless steel machine bolts, nuts and washers.</p>	
<p>6.2 <i>Change the last sentence to read:</i> Fan cylinder connection and anchorage hardware shall be series 300 stainless steel or type 316 stainless steel.</p>	
<p>8.3 <i>For an all stainless steel driveshaft change the second, third and fourth sentences to read:</i> Driveshaft tubes and flanges shall be manufactured of type 304 stainless steel. Couplings shall be cast 316 stainless steel, joined to the driveshaft by flexible neoprene bushings and type 316 stainless steel inserts. Connecting hardware shall be 316 stainless steel.</p> <p><i>Also, change the last sentence to read:</i> The driveshaft guards shall be epoxy coated after galvanizing to a dry film thickness of .31mm.</p>	<p>■ All of the material changes listed under Level 3 are recommended where chlorides are above 4000 mg/L (as sodium chloride) or above 2425 mg/L (as chloride) and where neither sulfides or ammonia are present.</p> <p>The materials of construction indicated in the base specification are entirely suitable for the "normal" water conditions defined on page 5. If your water quality is typified by the conditions indicated in the description above, all of the changes indicated on this page may be required. However, many of the components mentioned are outside contact with the circulating water stream and, therefore, may not require specification revision.</p> <p>Also, several other water chemistries can occur that may or may not necessitate changes in materials of construction and/or operating procedures. Prior to finalizing the tower selection and specification, we ask that you provide us with your best analysis of what your circulating water quality and chemistry will be.</p> <p>The value of the specification revision is, of course, that they help assure you will have achieved maximum longevity from your cooling tower in its anticipated operating environment.</p>

Specifications

For a carbon fiber driveshaft with 316 stainless steel couplings, replace the entire paragraph 8.3 with the description found on pages 15 and 16.

8.6 *Add the following sentence at the end of the paragraph:* Galvanized steel components shall be epoxy coated after galvanizing to a dry film thickness of .31mm.

8.7 *Change the last sentence to read:* The assembly shall be hot-dip galvanized after fabrication, and epoxy-coated after galvanizing to a dry film thickness of .31mm.

Driveshaft Material Options

All Stainless Steel Driveshaft:

8.3 *Replace the second, third and fourth sentences with the following:* Driveshaft tubes and flanges shall be manufactured of type 304 stainless steel. Couplings shall be cast 316 stainless, joined to the driveshaft by flexible neoprene bushings and type 316 stainless steel inserts. Connecting hardware shall be 300 series stainless steel.

Carbon Fiber Driveshaft / Stainless Steel Couplings:

8.3 *Replace the third paragraph with the following:* Motors shall be located outside the fan cylinders and shall be connected to the speed reducers by tubular, extended, full floating, non-lubricated driveshafts. Driveshaft tubes shall be carbon fiber/glass/epoxy composite. Flanges shall be manufactured of type 316 stainless steel, attached to the tube by type 316 stainless steel compression rings. Couplings shall be cast 316 stainless, joined to the driveshaft by flexible neoprene bushings and type 316 stainless steel inserts. Connecting hardware shall be 316 stainless steel. Driveshaft assemblies shall be dynamically balanced at the factory at full motor speed. Two triple-epoxy-coated, galvanized steel driveshaft guards anchored to the mechanical equipment support shall surround the driveshaft for containment in the event of failure.

Specification Value

■ Use where chloride levels in the circulating water and drift may exceed 750 ppm, as sodium chloride.

■ Carbon fiber driveshafts are preferred by many customers on the strength of their ability to remain dimensionally unaffected by long stationary periods in direct sunlight. Steel driveshafts may go through temporary unbalance in those circumstances.



Specifications	Specification Value
<p>Miscellaneous Options</p>	
<p>Fan Cylinder View Port:</p>	<ul style="list-style-type: none"> ■ Allows online viewing of fan operation.
<p><u>6.2</u> <i>Add the following to this paragraph:</i> Each fan cylinder shall include a 150mm diameter, screened view port with a removable clear plastic window.</p>	
<p>Vibration Limit Switch:</p>	<ul style="list-style-type: none"> ■ Unless specified otherwise, a Marley V6 mechanical vibration switch will be provided. The requirement for manual reset assures that the cooling tower will be visited to determine the cause of excessive vibration.
<p><u>8.8</u> <i>Add the following paragraph in the Mechanical Equipment section:</i> A vibration limit switch in a IP56 housing shall be installed on the mechanical equipment support and wired to the shutdown circuit of the fan motor starter or VFD. The purpose of this switch will be to interrupt control power voltage to a safety circuit in the event of excessive vibration causing the starter or VFD equipment to de-energize the motor. It shall be adjustable for sensitivity and include a means to reset the switch.</p>	
<p>Low Oil Switch:</p>	<ul style="list-style-type: none"> ■ Unless specified otherwise, a Robertshaw Level-Tek Model 5318B switch will be provided. This can be wired into a control or monitoring system.
<p><u>8.8</u> <i>Add the following paragraphs in the Mechanical Equipment section:</i> A solid state, capacitance-actuated, low oil level switch shall be provided and installed outside the fan cylinder for wiring into the owner's control panel.</p>	

Space does not permit definition and explanation of all of the possible options that can be applied to the F400 cooling tower. Please refer to the list below for options not covered in this publication and contact your SPX Cooling Technologies sales representative for additional information.

- Deep cold water basin
- Splash fill
- Hudson fan
- Full height partitions
- Fire protection sprinkler system
- Second layer of eliminators
- Variable frequency drives
- Hansen speed reducer
- Composite drive shaft
- Special design loads
- Severe duty
- Steel cold water basin
- Fit existing cold water basin
- Special inlet piping
- Custom stretch frame
- Clog resistant film fills
- Polypropylene high temp film fills
- Back-to-back cells
- Louvers
- Cofimco fan
- Fire-resistant fiberglass
- Lightning protection system
- Resin sealing of drilled holes and cuts
- Air inlet screens
- Architectural casing
- Structural design calculations
- Fiber reinforced cement board fire-wall
- Closed endwalls or sidewalls
- Fiberglass cold water basin
- Concrete basin design
- Vinyl ester resin
- Cantilever design
- SafPlank Fan Deck
- FRP Full Height Partition

F400 class
SPECIFICATIONS

SPX COOLING TECHNOLOGIES UK LTD

3 KNIGHTSBRIDGE PARK, WAINWRIGHT ROAD
WORCESTER WR4 9FA UK
44 1905 750 270 | ct.fap.emea@spx.com
spxcooling.com

uk_SPEC-F400-15 | ISSUED 11/2016
COPYRIGHT © 2016 SPX CORPORATION

In the interest of technological progress, all products are subject to design
and/or material change without notice.

